



Cabonne Council

Molong Sewage Treatment Plant Pollution Incident Response Management Plan

July 2024

Table of contents

1.	Back	ground	1
	1.1	Sewerage operations	1
	1.2	PIRMP purpose	1
2.	Pollut	tion Incident Response Planning	2
	2.1	Risk assessment	2
	2.2	Potential pollutants and safety equipment	4
	2.3	Maps	6
	2.4	Notifiable Incidents	6
3.	Incide	ent response	7
	3.1	Immediate notification incident	7
	3.2	General incident	10
4.	Train	ing and review	14
	4.1	Training	14
	4.2	PIRMP Review	14

Table Index

Table 2-1	Hazards	3
Table 2-2	Inventory of pollutants and safety equipment	5
Table 3-1	Incident Contact Details – Council	9
Table 3-2	Incident Contact Details – External	9
Table 4-1	Incident Response Training	14
Table 4-2	PIRMP review and test	15

Figure Index

Figure 3-1	Sewer Operations Incident Response Flowchart	8
Figure 3-2	Incident Response – Sewer choke	11
Figure 3-3	Incident Response – Pump station failure	12
Figure 3-4	Incident Response – Molong STP overflow	13

Appendices

Appendix A - Incident reporting forms

Appendix B - Maps

1. Background

1.1 Sewerage operations

Cabonne Council (Council) operates a sewerage scheme at Molong that operates under Environment Protection Licence (EPL) 1626. EPL 1626 is issued under Section 55 of the *Protection of the Environment Operations Act 1997* by the NSW Environment Protection Authority (EPA).

1.1.1 Molong sewage treatment scheme

The Molong scheme was constructed in 1979 and consists of three pumping stations, 25 km of underground mains, and a sewage treatment plant (STP) located to the north of Molong off the Mitchell Highway. Here, the sewage is treated biologically with an extended aeration "activated sludge" process. The product is discharged from a pasveer (circular treatment) channel into a large effluent pond for further polishing and UV disinfection before it is discharged into the Molong Creek.

1.2 PIRMP purpose

The EPL contains a requirement to report pollution incidents as outlined in Section 6, Reporting conditions:

The licensee or its employees must notify the EPA of incidents causing or threatening material harm to the environment immediately after the person becomes aware of the incident in accordance with the requirements of Part 5.7 of the Act:

- R2.1 Notifications must be made by telephoning the EPA Environment Line on 131 555.
- R2.2 The licensee must provide written details of the notification to the EPA within seven days of the date on which the incident occurred.

2. Pollution Incident Response Planning

2.1 Risk assessment

The risk assessment was reviewed on site between GHD and site personnel during testing of the PIRMP on 1 August 2019. The main hazards identified and control measures to minimise the occurrence and consequences (people and environment) of the identified risks are outlined in Table 2-1.

Table 2-1 Hazards

Location	Hazard	Control Measure/s	Consequence	Likelihood of material harm	Escalating Factors
STP	Insufficient treatment – wet weather overflow	 UV disinfection Daily site risk assessments Incident response procedures On site water quality analysis Dilution from infiltration throughout the sewer network and creek flows 	 Pollution of downstream waterbody 	Low	Significant rainfall eventPlant malfunction
	Spill of chemicals / fuels / oils	 Staff training in use Appropriate storage Small quantities of chemicals / fuels / oils stored 	Localised soil contamination	Low	 Inappropriate storage of chemicals / fuels / oils Use of chemicals / fuels / oils by untrained staff
	Spill of untreated sewage to land – wet weather overflow	 Staff on call Maintain equipment for sewage clean up and unblocking sewers 	Localised soil contamination	Low	Significant rainfall event
Sewer reticulation network	Spill of untreated sewage to land – sewer choke	 24hr Customer Service Staff on call Maintain equipment for sewage clean up and unblocking sewers 	 Localised soil contamination Community contact with untreated sewage Discharge of untreated sewage to waterways 	Low	 Increase in solids content of sewage Unauthorised material discharged to sewer network Proximity of sewer choke to sensitive receptors
	Spill of untreated sewage to land – pump station failure	 Regular inspections 24hr Customer Service Staff on call 	 Localised soil contamination Community contact with untreated sewage Discharge of untreated sewage to waterways 	Low	 Increase in solids content of sewage Unauthorised material discharged to sewer network

2.2 Potential pollutants and safety equipment

A number of potential pollutants are stored, used and disposed of at the Molong STP for operational activities. These include chemicals, fuels, oils, lubricants, cement, lime, and treated and untreated sewage.

A range of safety equipment and alarms are maintained at the Molong STP and throughout the sewer network for use during emergencies.

Details of potential pollutants and safety equipment are provided in Table 2-2. The location of the items listed is shown on the maps in Appendix B.

Location	Potential Pollutant	Maximum Quantity	Storage	Safety Equipment and Devices	Alarms		
Pump stations	Sewage	Site specific	N/A	Standby pumpsBunds	High level alarms connected to telemetry		
Sewer reticulation network	Sewage	Site specific	N/A	N/A	Nil		
Molong STP	Sewage	ADWF 500 kL/day (approx.)	N/A Shed	Rubber glovesFace masks	 Pager system to notify operators of 		
	For Earth	100 L		Mobile pump	power outages and		
	Oils	40 L		Float switch and level sensor (STP wet	pump station		
	Roundup	20 L		weather shutdown)	shutdown		
	Hydrated lime	200 kg		• • • •	Firefighting equipmentSDSs		
	Fuel	10 L				First aid kit	
	Disinfectant	5 L			 Signage PPE including ear protection, hard hats, ear plugs, appropriate footwear, high vis vests 		
Volong Depot	Oils	40 L	Shed	 Gas monitoring equipment Rakes, shovels, sand and hydrated lime Pressure cleaner, rods and electric eel Confined space PPE Firefighting equipment SDSs First aid kit 	Nil		

Table 2-2 Inventory of pollutants and safety equipment

2.3 Maps

Pollution incident response maps have been prepared to facilitate planning for incident response and provide readily accessible and accurate information to support the assessment of an incident and assist in the implementation of incident response procedures and clean-up.

The following maps are provided in Appendix B.

- Molong locality map
- Molong STP features map

2.4 Notifiable Incidents

2.4.1 POEO Act Definitions

A pollution incident is defined by the POEO Act as:

An incident or set of circumstances during or as a consequence of which there is or is likely to be a leak, spill or other escape or deposit of a substance, as a result of which pollution has occurred, is occurring or is likely to occur. It includes an incident or set of circumstances in which a substance has been placed or disposed of on premises, but it does not include an incident or set of circumstances involving only the emission of any noise.

Material harm is defined by the POEO Act as:

(1) For the purposes of this Part:

(a) harm to the environment is material if:

(i) it involves actual or potential harm to the health or safety of human beings or to ecosystems that is not trivial, or

(ii) it results in actual or potential loss or property damage of an amount, or amounts in aggregate, exceeding \$10,000 (or such other amount as is prescribed by the regulations), and

(b) loss includes the reasonable costs and expenses that would be incurred in taking all reasonable and practicable measures to prevent, mitigate or make good harm to the environment.

(2) For the purposes of this Part, it does not matter that harm to the environment is caused only in the premises where the pollution incident occurs.

Licensed facilities are required to report pollution incidents immediately to the EPA, NSW Health, Fire and Rescue NSW, WorkCover NSW and the local council. 'Immediately' has its ordinary dictionary meaning of promptly and without delay.

3. Incident response

3.1 Immediate notification incident

3.1.1 Incident response and notification

As per the definition of an immediate notification incident in section 2.4.1 and resulting from the risk assessment in Table 2-1, Council have identified the following incidents related to their sewer operations that require immediate notification:

- Pump station failure resulting in overflow to a waterway
- Sewer choke resulting in an overflow to a waterway.

Council's procedures for responding to a potential immediate notification incident are outlined in Figure 3-1.

Contact details for Council personnel and external agencies requiring notification are provided in Table 3-1 and Table 3-2.

Incident occurs

Incident involves material harm to people or the environment

Call 000 or 112 Emergency Services if personnel are injured or firefighting response required

> First sewer staff respondent shall notify the Water and Waste Water Overseer who then manages the incident response

> Water and Waste Water Overseer notifies the Department Leader – Utilities who manages council and external notifications as per table 3-2

Direction given by inspector and / or corrective actions as advised by appropriate authority are to be implemented immediately.

Advise Director of Engineering and Technical Services of the implementation of all corrective actions.

Figure 3-1 Sewer Operations Incident Response Flowchart

Table 3-1 Incident Contact Details – Council

Name	Position	Contact Number
Jarrad Meade	Water & Waste Water Overseer	0474 782 170
Charlie Harris	Department Leader – Urban Services & Utilities	0437 295 896

Table 3-2 Incident Contact Details – External

Organisation	Contact Number
Emergency Services	000
NSW EPA	131 555
SafeWork NSW	131 050
Essential Energy	132 080
NSW Health – Bathurst Public Health Unit	(02) 6330 5880
	0428 400 526

In the event of an immediate notification incident, responsibilities for incident management are as follows:

- On Call Supervisor is responsible for actioning response to the incident.
- Water & Waste Water Overseer is responsible for managing the incident response.
- Department Leader Urban Services & Utilities is responsible for notifying external authorities, potentially affected community and ensuring adequate resources are available for incident response.

The Operations Manager shall determine the most appropriate means of contacting potentially affected community including:

- Door knocking
- Letterbox drops
- Phone
- Local media
- Signage
- Social media.

Information provided to the community would depend on the incident but could include:

- Description of the incident
- Status of incident
- Response actions
- Actions to minimise harm
- Likely duration.

As per EPL 1626, the licensee must provide written details of the notification to the EPA within seven days of the date on which the incident occurred.

3.2 General incident

3.2.1 Sewer operations

Council maintain incident response procedures for other potential incidents throughout the sewer network including:

Sewer choke - Figure 3-2

- Pump station failure Figure 3-3
- STP overflow Figure 3-4.

The EPL requires details of the incidents be recorded as per the Sewage Overflow Reports (Appendix A) and maintained by Council.

Where there is an observed or reported overflow from the reticulation system or where sewage or partially treated sewage is discharged from the premises as a result of a bypass of the treatment system and this overflow or bypass has the potential to impact on human or environmental health, the licensee is to promptly give appropriate notification to any parties that are likely to be affected, including:

- The affected community
- NSW Health and any other relevant authority in accordance with condition R2.1
- The Molong Creek and Tributaries Management and Protection Association Incorporated (in pollution of waterways), and
- Any other parties as identified in, and in accordance with, the Incident Notification Procedures (protocol) submitted to the EPA in a letter from the licensee dated 8 October 2004, or subsequent approved variation/s to this protocol as updated from time to time.

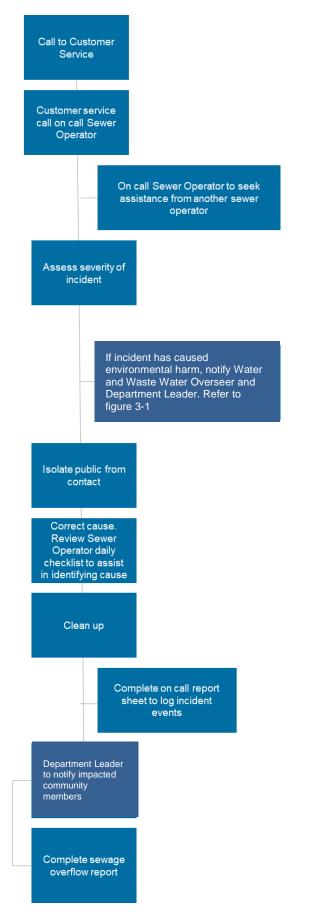


Figure 3-2 Incident Response – Sewer choke



Figure 3-3 Incident Response – Pump station failure



Figure 3-4 Incident Response – Molong STP overflow

4. Training and review

4.1 Training

Personnel involved in sewage operations undertake a range of training to assist in the response to potential incidents and to test the adequacy of incident response procedures and plans. Details of the training and testing of the PIRMP is provided in Table 4-1.

Table 4-1 Incident Response Training

Type of Training	Personnel Involved	Frequency	Records
Overflow clean up	New Sewer staff	On-the-job for first 6 months prior to going on the On Call roster	Nil
NSW Officer of Water Part 1 – Water Treatment Operations	Sewer Operators	Once	Human Resources
NSW Officer of Water Part 2 – Advanced Treatment	Sewer Operators	Once	Human Resources
Confined space	Sewer staff	As required by training provider	Human Resources
Toolbox meetings	Sewer staff	Fortnightly	Minutes
PIRMP test	Relevant Sewer staff	Annual	Minutes
Incident debrief	Personnel involved in incident Independent chair	Within one month of an incident	Minutes

4.2 **PIRMP Review**

The guidelines require the PIRMP to be reviewed annually. The PIRMP will be updated when there is a material change to operations including but not limited to:

- Modification of EPL 1626
- Changes in standard operating procedures referred to in this PIRMP
- Completion of Water Quality Management Plan risk assessment for licensed sites
- Change in legislative requirements
- Recommendations arising from an incident debrief, emergency drill or emergency simulation exercise.

The responsibility for reviewing the PIRMP is the Operations Manager Urban Services and Utilities.

Records of PIRMP review and testing is provided in Table 4-2.

An update of the PIRMP would trigger all staff to undergo refresher training as part of toolbox meetings as per Table 4-1.

Issue	Date	Reviewed by	Description		
PIRMP Review					
1	August 2012	Council Sewer personnel GHD	Initial document prepared to meet the PIRMP guidelines		
2	August 2019	Council Sewer personnel GHD	Create a separate PIRMP for the Molong Sewage Treatment Scheme Removal of references to transferred EPLs General PIRMP update		
3	March 2020	Council Sewer personnel GHD	General PIRMP update Revision of Incident Response flow charts		
4	July 2024	Council Sewer personnel	Council contact details update Revision of Incident Response flow charts		
PIRMP Testing					
1	1 August 2019	Council Sewer personnel GHD	PIRMP desktop scenario test with Sewer personnel		
2	March 2020	Council Sewer personnel GHD	PIRMP desktop scenario test with Sewer personnel		
3	July 2024	Council Sewer personnel	Desktop scenario for a sewer spill Thistle St SPS		

Table 4-2 PIRMP review and test

Appendices

Cabonne Council - Molong Sewage Treatment Plant PIRMP

Appendix A - Incident reporting forms



MOLONG SEWERAGE SCHEME

SEWERAGE OVERFLOW REPORT

This form is to be completed by the Duty Operator in the event of sewerage surcharge to the Molong Creek or tributaries or surcharge from the system.

1. Surcharge to the Molong Creek or tributaries.

Location	
Cause of Surcharge	
Action taken to stop surcharge	
Estimated duration & quantity: Time:	Quantity:
Clean up action taken	******
Sample taken; one downstream & one ups	
	Time:
Sample sent to:	

Samples to be tested for dissolved oxygen, pH, P, N, chlorophyll-a, turbidity and faecal bacteria.

Surcharge	from St	ystem
-----------------------------	---------	-------

•	Location	
•	Cause of surcharge	
•	Action taken to stop surcharge	
•	Estimated duration of surcharge	
•	Clean up action taken	
•	Assessment of – BOD & Suspended Solids	
Repor	ted ByDate:	
Repor	t received and entered in database by:	
Date:		
Test results received and entered in database by:		
Date:		
Any fu	In the Action Required?	
	•	

.

Services & Development Engineer

Date:_____

Appendix B - Maps



ΜN

Grid - Magnetic 10.5°

TN

This map is not a precise survey document. Accurate locations can only

CABOI Cabonne Council 101 Bank Street PO Box 17 MOLONGNSW 2866 Ph: (02) 6392 3200 Fax: (02) 6392 3260 Email: <u>council@cabonne</u>

This map is not a precise survey document. Accurate locations can only be determined by a survey on the ground.. This information has been prepared for Council's internal purposes and for no other purpose. No statement is made about the accuracy or suitability of the information for use for any purpose (whether the purpose has been notified to Council or not). While every care is taken to ensure the accuracy of this data, nether the Cabone Council nor the Department of Lands makes any persentations or warranties about its accuracy, reliability, completeness or suitability for any particular purpose and disclaims all responsibility and all liability (including without limitation, liability in negligence) for all expresses, losses, damages (including indirect or consequential damage) and costs which you might incur as a result of the data being inaccurate or incomplete in any way and for any reason.

for any reason. © The State of New South Wales (Department of Lands) 2009, © Cabonne Council 2009

True North, Grid North and Magnetic North are shown diagrammatically for the centre of the Cabonne Local Government Area. Magnetic North is correct for 2001 moving easterly by 0.04° in about five years.

Important This may way produced on the GEOCENTRIC DATUM OF AUSTRALIA 1994 (ACDPG(WA), Heights are referenced to the Australia Height Datum (A1991 (ACDPG(WA), Heights are referenced to the Australia Height Datum (AHD) heights for most practical purposes GOA94 coordinates and skellite derived (CPS) coordinates based on the World Geodetic Datum 1994 (WGS84) are the same.

GDA


Contour Interval: Projection: Cost: Date:

MGA94 Zone 55

Monday, 22 July 2024

Molong

Map Scale: 1:22,220 at A4 Map Zoom: 6307 m

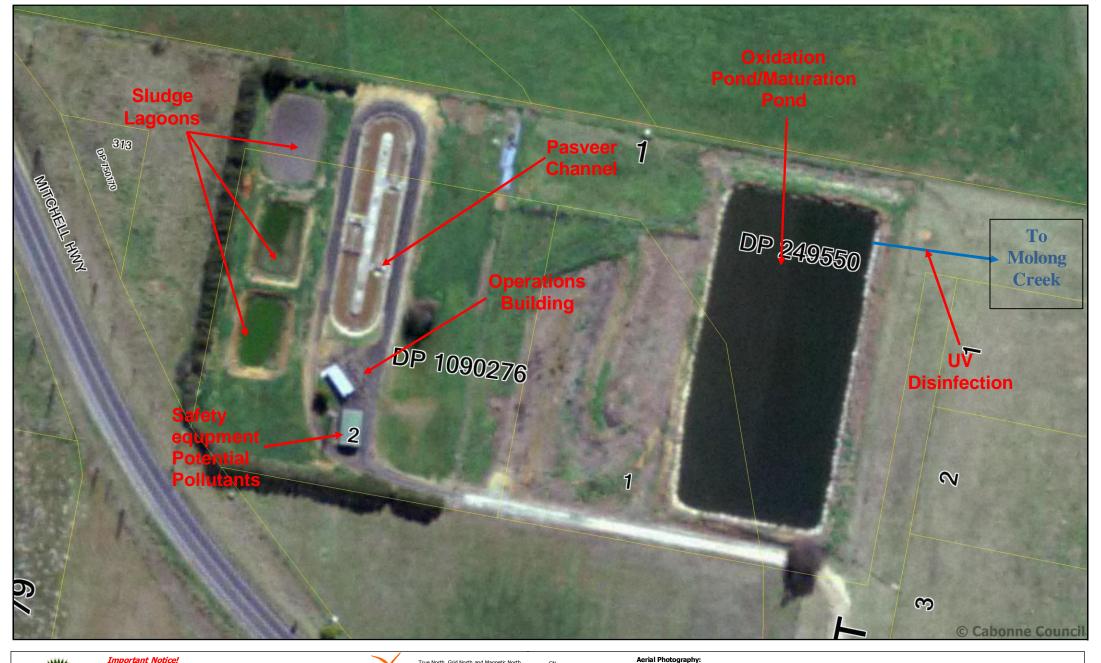

GN

MN TN I

Grid - Magnetic 10.5°

Important Notice! This map is not a precise survey document. Accurate locations can only be determined by a survey on the ground.

CABONNE COL

Cabonne Council 101 Bank Street PO Box 17 MOLONGNSW 2866 Ph: (02) 6392 3200 Fax: (02) 6392 3260 Email: council@cabonne

This information has been prepared for Council's internal purposes and for no other purpose. No statement is made about the accuracy or suitability of the information for use for any purpose (whether the purpose has been notified to Council or not). While every care is taken to ensure the accuracy of this data, neither the Cabonne Council nor the Department of Lands makes any accuracy or units data, neurer the catorine council nor the Department of Latios markes any representations or warranties about its accuracy, reliability, completeness or suitability for any particular purpose and disclaims all responsibility and all liability (including without limitation, lability in negligence) for all expenses, losses, damages (including indirect or consequential damage) and costs which you might incur as a result of the data being inaccurate or incomplete in any way and for any reason. © The State of New South Wales (Department of Lands) 2009, © Cabonne Council 2009

True North, Grid North and Magnetic North are shown diagrammatically for the centre of the Cabonne Local Government Area. Magnetic North is correct for 2001 moving easterly by 0.04° in about five years.

Important This may was produced on the GEOCENTRIC DATUM OF AUSTRALIA 1994 (CDAP4), which has supersedued the Australian Geographic Datum of 1984 (CDAP4), which has supersedued to the Australia Height Datum (AHD) heights for most practical purposes CDAP4 coordinates and stellite derived (GFS) coordinates based on the World Geodetic Datum 1984 (WGS84) are the same.

Contour Interval Projection:

MGA94 Zone 55 Cost: Date: Monday, 22 July 2024

Molong STP

Map Scale: 1:1,197 at A4 Map Zoom: 339.7 m

GDA

Cabonne Council

99-101 Bank St, T: 61 2 6392 3234 E: council@cabonne.nsw.gov.au

© Cabonne Council 2024

Document Status

Revision	Author	Reviewer		Approved for Issue		
		Name	Signature	Name	Signature	Date
0	B Foster	D Scott	*D Scott	D Mees	*D Mees	3/09/2019
1	G Rogers	D Scott	Bet	D Mees	filces .	20/05/2020
2	Nadun Wishvanath	Charlie Harris		Charlie Harris		22/07/2024

www.cabonne.nsw.gov.au

